


EXTERNAL ELECTRICAL CONNECTIONS FOR 17600 CONTROL INTERFACE

14-2645A
6-95

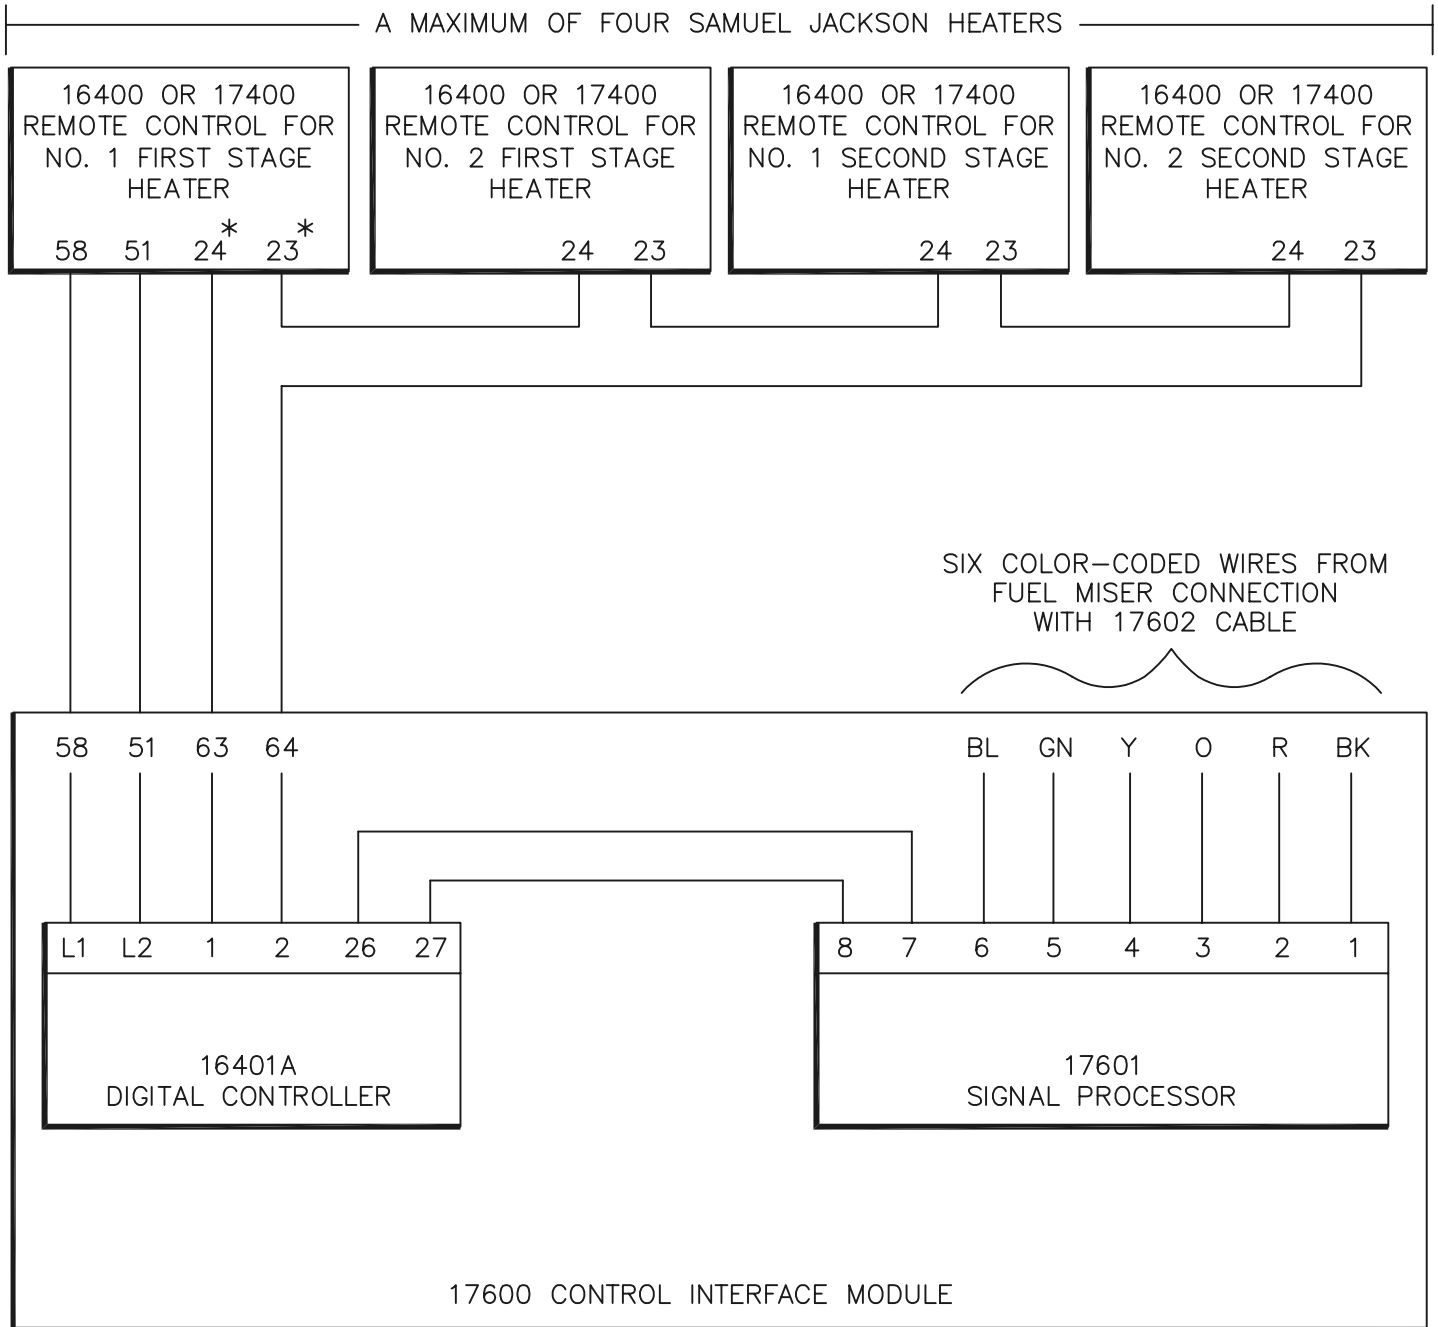

* TERMINALS 24 AND 23 ARE ON BACK OF 16401A DIGITAL TEMPERATURE CONTROLLER FOR BLUE UDC-3000 CONTROLS MAKE THE FOLLOWING TERMINAL SUBSTITUTIONS: 10 FOR 23, 11 FOR 24, 17 FOR 26, 18 FOR 27, AND 1 FOR 3.